




19" 20-Outlet Rack Mount Power Strip Model MS2015

Rackmount Installation:

These devices are only intended for mounting to carts, racks and other relocatable apparatus and are not to be mounted on structural members or other permanently secured apparatus. To Mount Unit in Rack: Put four user-supplied rackmount screws through the unit's mounting ears and into the rack rails. The user must determine the fitness of the rackmount screws to hold the unit in the rack before installation.

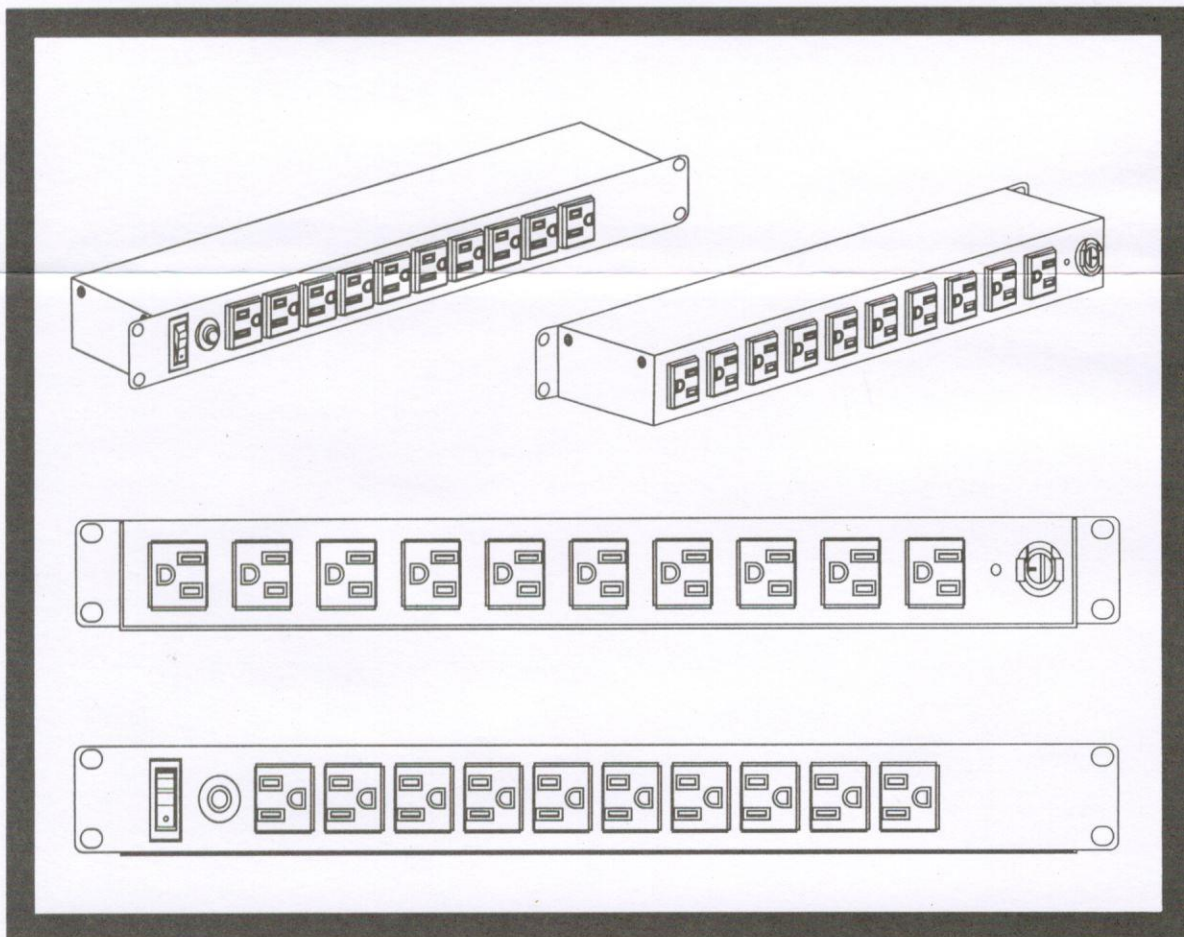

A-Neutronics, Inc.
Frisco, Texas

Telephone: 1-(877)-aneutronics 1-(877) 263-8876
Email: Sales@a-neutronics.com Web: www.a-neutronics.com